

Board of Supervisors

Robert "Bob" Thomas, Jr., Chairman
Laura A. Sellers, Vice Chairman
Meg Bohmke
Jack R. Cavalier
Wendy E. Maurer
Paul V. Milde, III
Gary F. Snellings

C. Douglas Barnes
Interim County Administrator

October 26, 2016

RFP #113163

ADDENDUM #1

The following information is provided for Bid #113163 for the Construction of the Falls Run Interceptor Sewer 95 Crossing Project for the Stafford County Department of Utilities. All prospective Bidders are hereby advised to make the changes to the Bid Documents in their possession as follows:

General:

1. This Addendum is hereby made a part of the Contract Documents issued to modify, alter, revise or explain the original drawings and/or specifications. The contents of this Addendum will take precedence over the original instruments and shall be bound with the specifications.
2. All Offerors shall acknowledge the receipt of this Addendum in the space provided on Page 300-2 of the Bid Form.

The purpose of Addendum #1 is to make additions/deletions/changes to the Bid Specifications. Please acknowledge receipt of this addendum on your Bid Form.

Please note the following modifications to the Technical Specifications:

Section 02730 – Sanitary Sewers

Paragraph 2.02C – Shall read as follows:

1. **Use inside limits of steel casing utilizing Owner provided pipe. Pipe length provided may not be full required length. For use outside of steel casing, install HDPE pipe per detail provided with this addendum.**
2. **AWWA C 906, PE 3408, DR 21, or as specified on plans.**



Plan Sheet 4 – Please add the following:

The contractor is not to install the 30” Gate Valve or the 15” Gate Valve as shown. The 15” Gate Valve is about 5’ east of Manhole 62 and the 30” Gate Valve is 5’ west of Manhole 58.


The size of Manhole 59 and Manhole 62 will increase from 84” to 96”.

Manhole 58 Shall have a Watertight Frame and Cover (including replacement of the vent)

Question and Answer

Can the Contractor use 60” Permalok casing for the bore under I-95? That’s the smallest diameter available that allows cutter changes during the drive.

Response: Yes, as long as the Contractor acquires VDOT approval the use of this product.

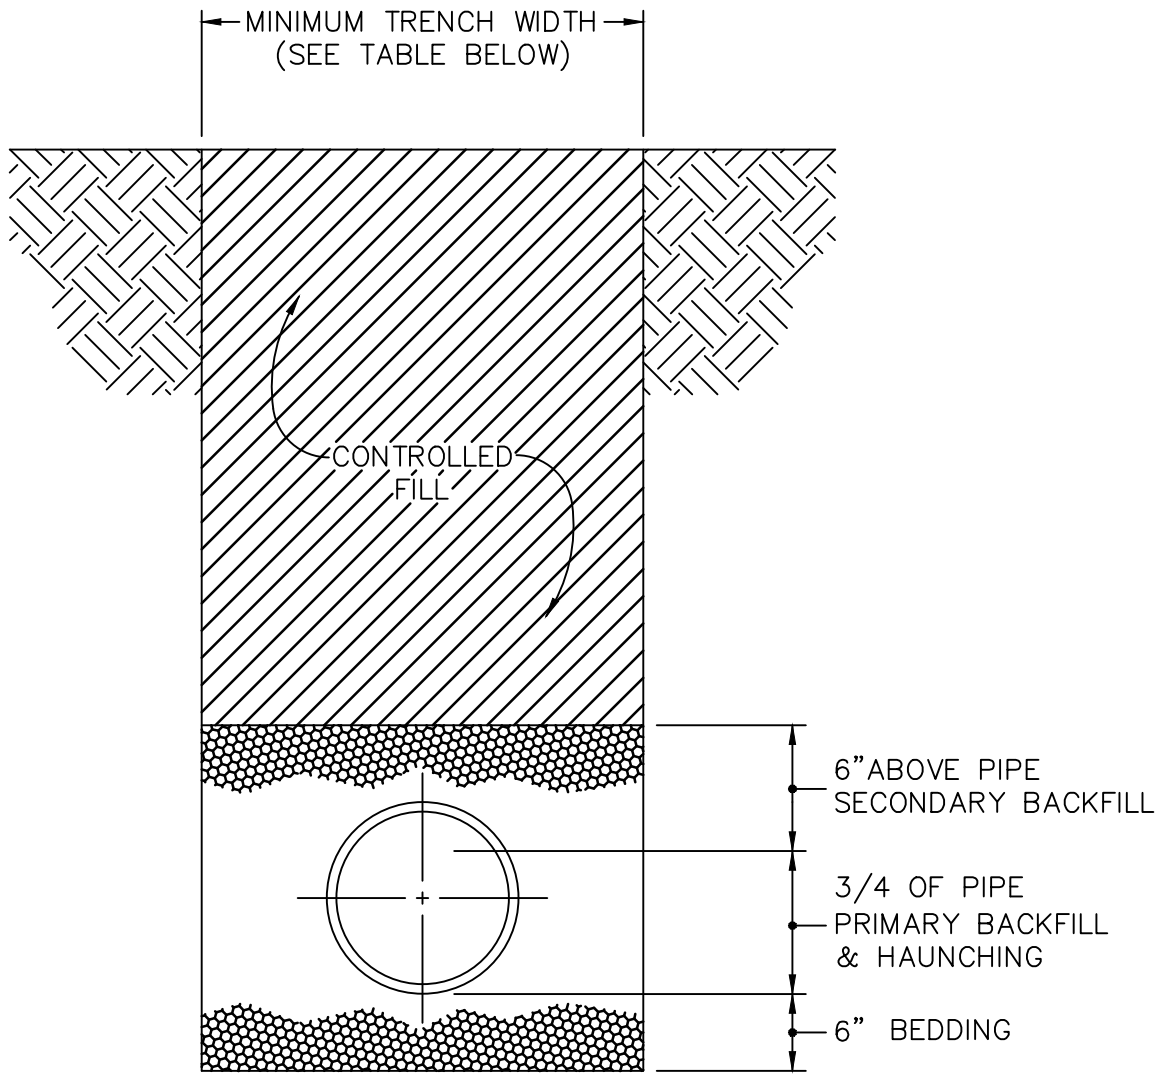

PIPE DIAMETER	MINIMUM TRENCH WIDTHS
	HDPE PIPE
18"	36"
30"	48"

NOTES:

- INITIAL BACKFILL SHALL INCLUDE BEDDING, HAUNCHING, PRIMARY AND SECONDARY INITIAL BACKFILL AND SHALL BE VDOT #57 STONE. INSTALLED PER THE CONTRACT SPECIFICATIONS.

HDPE DIRECT BURY TRENCH DETAIL

ADDENDUM #1 HDPE DIRECT BURY TRENCH DETAIL
FALLS RUN INTERCEPTOR SEWER
INTERSTATE 95 CROSSING

SCALE: NTS

PROJECT: R06515-07

STAFFORD COUNTY, VA



Draper Aden Associates

Engineering • Surveying • Environmental Services

8090 Villa Park Drive Blacksburg, VA Coats, NC
 Richmond, VA 23228 Charlottesville, VA Fayetteville, NC
 804-264-2228 Fax: 804-264-8773 Hampton Roads, VA Northern Virginia

DESIGNED: BSC
DRAWN: BSC
CHECKED: MSH
DATE: 10/25/2016